

IREDELL COUNTY HEALTH DEPARTMENT

STATESVILLE 704-878-5305

MOORESVILLE 704-664-5281

325


IMPROVEMENT PERMIT / AUTHORIZATION TO CONSTRUCT / OPERATION PERMIT / EXISTING SYSTEM INSPECTION

PERMIT# 078376/116258 PIN# H625941684 (ot) Eloed Custom Homes #626-90-4769 DATE May 4, 99
 OWNER OR CONTRACTOR Crescent Reservoir Inc / The Point on Norman PHONE: Business 660-1185 Home _____
 ADDRESS 2214 Bramley Sch Rd. Mooresville
 LOCATION Bramley Sch Rd. TL Great Point Drive TL Whaling Lane at end
 SUBDIVISION The Point BLOCK / SECTION 14 LOT 290 LOT AREA 41,838 ft² SITE CLASS. B DESIGN FLOW 480 gpd L.T.A.R. 0.3

Septic Tank: <u>1000</u> Gallons; STB <u>330</u> Date <u>4/30/04</u>	<input checked="" type="checkbox"/> New System <input type="checkbox"/> Repair System Type: I, II, III, <u>IV</u> , V, VI	<input checked="" type="checkbox"/> House/Mod. Home No. Bedrooms <u>4</u>	Water Supply: <input type="checkbox"/> Individual <input checked="" type="checkbox"/> Public <input type="checkbox"/> Community
Pump Tank: <u>1000</u> Gallons; PT <u>283</u> Date <u>4/30/04</u>	System Description: <u>LP PANEL BLOCK</u>	<input type="checkbox"/> Mobile Home No. Bathrooms <u>4</u>	
Pump Make: <u>Goulds</u> Model <u>WEO-1021HHS</u> Serial No. <u>C0362155</u>	Repair System Description: <u>LP PANEL BLOCK</u>	<input type="checkbox"/> Business No. Employees _____	
Nitrification Field/ No Fields <u>1</u> Square Feet <u>870</u> Linear Feet <u>290</u>	Maintenance Agreement Required: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Other _____	
No Lines <u>4</u> Trench Width <u>36"</u> Max Trench Bottom Depth <u>36"</u>	Gravel Depth <u>NA</u> <input checked="" type="checkbox"/> Slab <input checked="" type="checkbox"/> Crawl Space <input type="checkbox"/> Basement w/plumbing <input type="checkbox"/> Basement wo/plumbing		

Comments/Conditions:

Comments/Conditions: Addressed surface water issues with Eloed, Benharter and Orlin Jones. Everyone stated runoff will be directed away from the pump tank 6/18/04

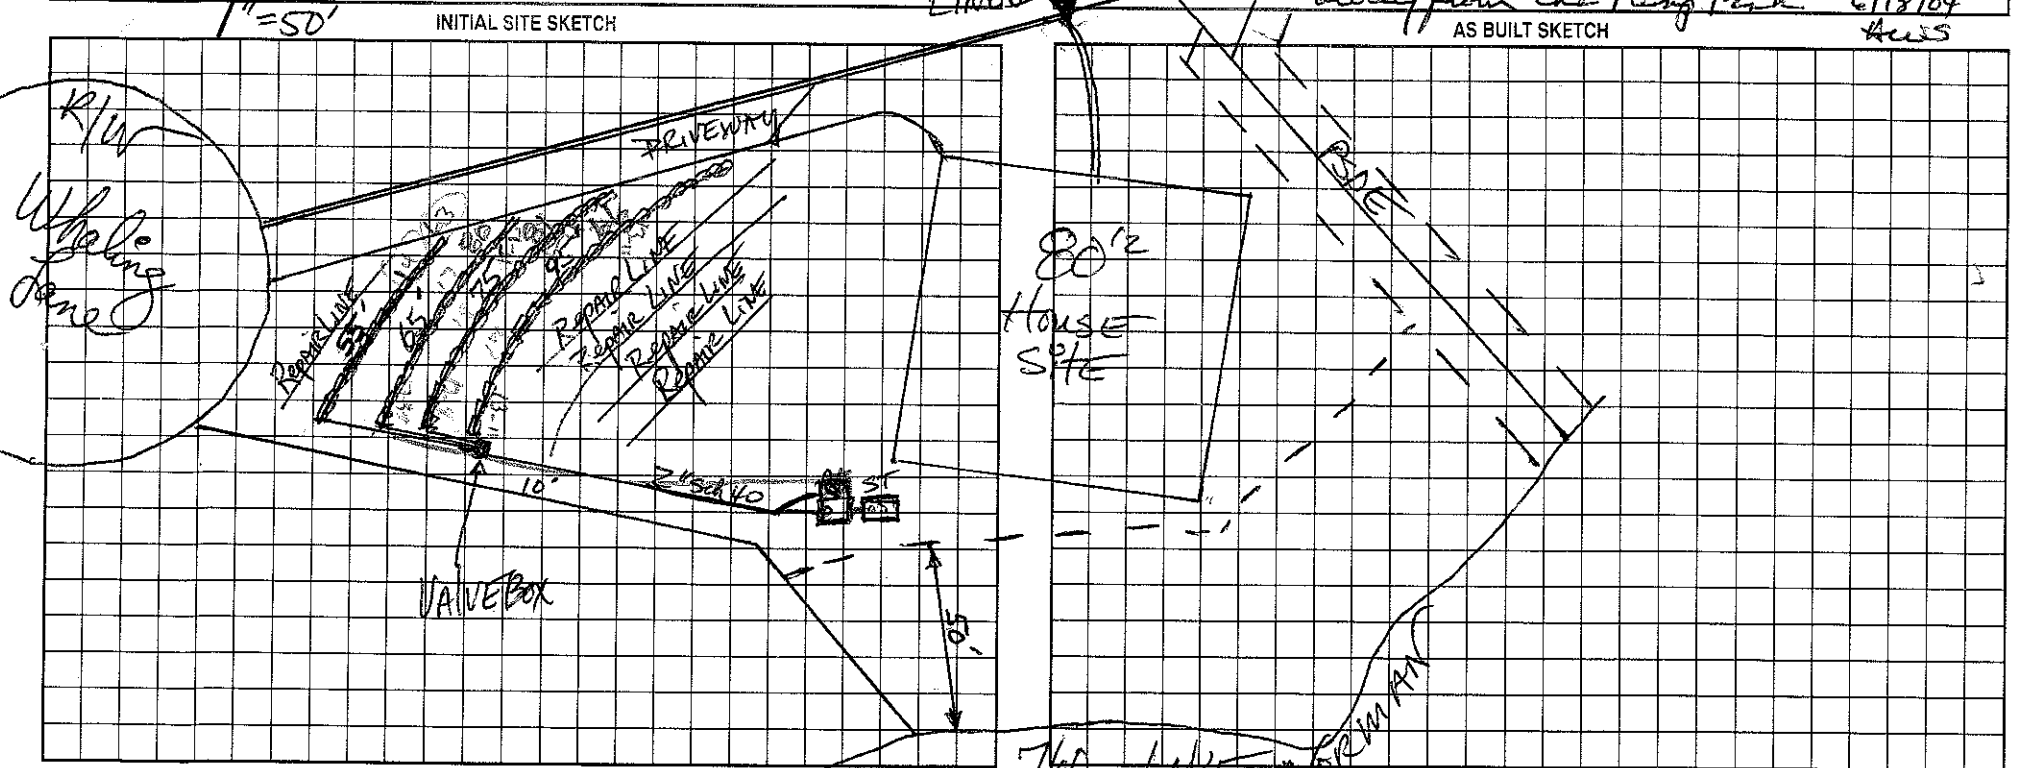

Permit can be suspended or revoked if any false information is supplied toward securing the permit/any unauthorized changes are made to the site/any unauthorized changes are made in the installation of the system. Improvement Permit with plat valid without expiration. Improvement Permit with site plan valid for sixty months. Authorization to Construct is valid for a period equal to that of Improvement Permit - not to exceed sixty months.

Signed: [Signature] date 5-14-99 Installed by: [Signature]
 Improvement Permit by: [Signature] date 5-4-99 Operation Permit by: Wesley Sparks RS. date 6/18/04
 Authorization to Construct by: [Signature] date 9-30-03 Existing System Inspection by: _____ date _____